


APPROVED

By Oregon DEQ at 2:24 pm, Nov 09, 2007

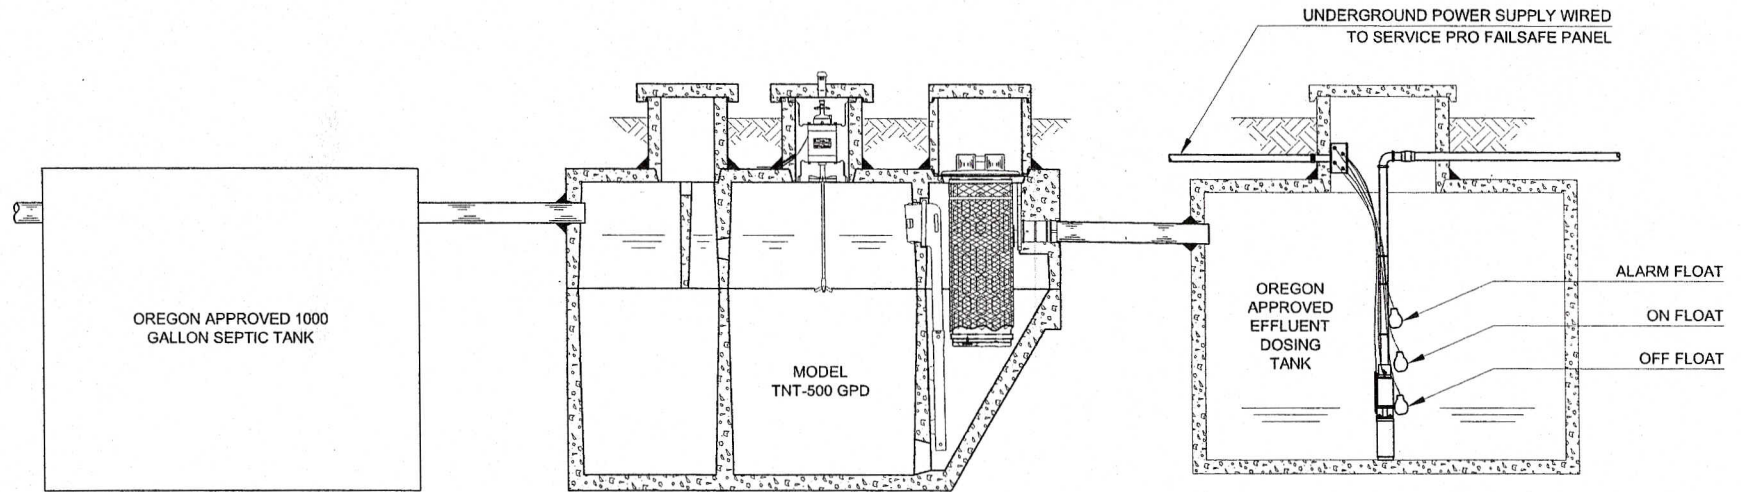

TREATMENT STANDARD #1 - PRESSURE DISTRIBUTION TO RECEIVING ENVIRONMENT

GENERAL NOTES:

1. FAILSAFE CONTROLS WILL SHUT DOWN EFFLUENT PUMP IF THERE IS A MALFUNCTION IN THE AERATOR OPERATION.
2. FAILSAFE CONTROLS WILL ALARM AND NOTIFY THE SERVICE PROVIDER IN THE EVENT OF A MALFUNCTION.
3. FAILSAFE CONTROLS WILL ALARM IF EFFLUENT LEVEL REACHES THE ALARM FLOAT.

PART NUMBER:	
U.S. AND FOREIGN PATENTS PENDING	norweco
© MMVII	TREATMENT STANDARD #1 FLOW THROUGH SCHEMATICS
DESIGNER	10-18-07
DRAWN BY	BDS
APPROVED BY	JMM
DATE	8-29-07
SCALE	NTS
REVISIONS	PC-5-9935